

130W/52V Desktop Power Adapter(With Certification) (GWS-AP130-52C)



Features



- Power Input: AC90~264V
- Support production for short circuit/over current/over voltage
- ➤ Wide operating ambient temp (-20 °C~65 °C)
- > 100% full load aging test
- High efficiency, long life time and high reliability
- No fan, completely tranquil work
- 3 years warranty


Technical Specification

| Model | | | GWS-AP130-52C |
|----------------|------------------------------|--|---|
| | Group Of Output | | 1 |
| | DC Voltage | | 52VDC |
| | Default Output Voltage | | 0-2.5A |
| | Ripple N | 0 <ta≤55°c< td=""><td>≤50mVp-p</td></ta≤55°c<> | ≤50mVp-p |
| | | oise <mark>-15≤Ta≤0</mark> °C | ≤100mVp-p |
| | Stabilized Voltage Precision | | ±1% |
| | Line Regulation | | ±1% |
| | Load Regulation | | ±1% |
| | Temperature Coefficient | | ±0.03%/℃ |
| | Output Start Time | | ≤3.0S (120Vac input, Full load); ≤2.0S (220Vac input, Full load) |
| | Output Hold Time | | ≥10mS(120Vac input, Full load); ≥20mS(220Vac input, Full load) |
| | Voltage Overshoot | | <5.0% |
| | Input Voltage Range | | 90VAC~264VAC |
| | Input Rated Voltage Range | | 100VAC~240VAC |
| | Frequency Range | | 47Hz~63Hz |
| Input | Efficiency | | 91% |
| | Input Current | | <1.1A |
| | Inrush Starting Current | | <40A@300Vac Cold start; |
| | Leakage Current | | input to output less than 0.25mA |
| Protecti on | Output | Over Power | 156~195W Swing machine (Testing method: Increase the output current until enabling the protection. Protection mode:Swing machine, Self-recovery after over-power released.) |
| | | Over Voltage | 59-60V Swing machine (Short circuit the Pin1-2 of U8, swing machine. Output recovery to normal after removing the short circuit) Note: Do not use external voltage. |
| | | Over Current | 3~3.2A Swing machine (Testing method: Increase the output current until enabling the protection. Protection mode:Swing machine, Self-recovery after over-current released.) |
| | | Short Circuit | It can be short circuited for a long time and automatically recover after the short circuit is eliminated. |




| on | Humidity | -20℃~65℃; 20%~90%RH No condensing | | |
|---------------------------------|--|--|--|--|
| ment | Humidity | -40℃~85℃; 5%~95%RH No condensing | | |
| Certifica tion | 3C.CE. FCC.EMI/EMC | | | |
| | Security Standard | GB4943/EN60950 | | |
| Safety And EMC Standar | Dielectric Strength | Input—Output:3KVac/10mA; InputCase:1.5KVac/10mA; OutputCase:0.5KVDC/10mA Time for each testing is 1min. | | |
| d | Insulation Resistance | Input-Output: 100M ohms; Input-Case: 100M ohms; Output-Case: 100M ohms; | | |
| | Electromagnetic Interference EN55022 Class A | | | |
| | Harmaonic Current | IEC61000-3-2 class A equipment requirements | | |
| | Electromagnetic interference Immunity | EN61000-4-2,4,5,6,8,11 ENV50204, class A heavy industry standard | | |
| Others | Design MTBF | 100,000Hrs AT 25℃, MIL-217 Method 2 Components Stress Method | | |
| | Product size(L*W*H) | 172*72*34mm | | |
| Notes | If the specification is not specified, all specifications and parameters shall be measured at rated input, rated load and 25 C ambient temperature. Ripple noise test method: the use of a 12# twisted pair, while the terminal to parallel capacitance of 0.1uF and 10uF, measured at the scope of the oscilloscope 20MHz bandwidth. The power supply will be installed on the final equipment as a component, and the final equipment will still have to meet the EMC condition. | | | |

Dimension

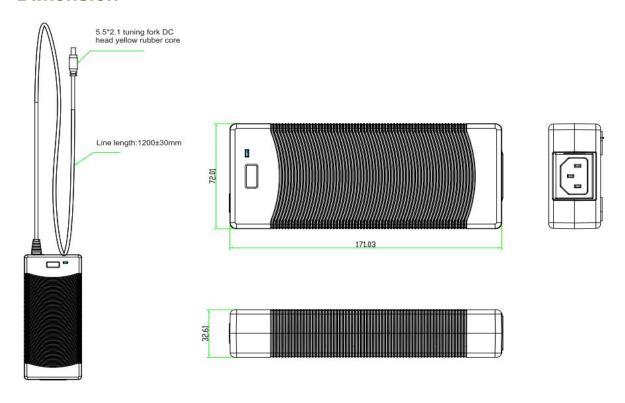





Block Diagram

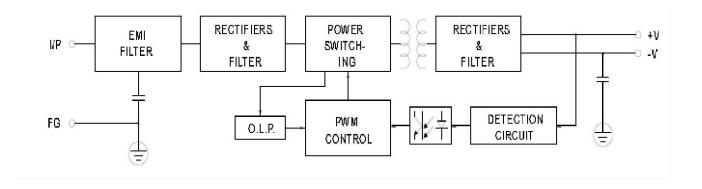

Derating Curve

Static Characteristic Curve

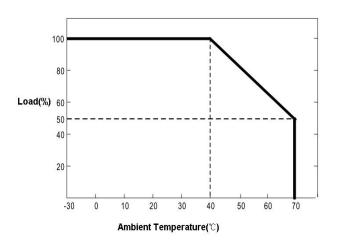

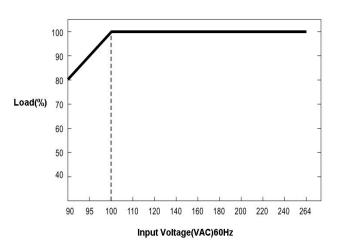

Contact Us

Gwspower

Tel: 0086-755-33376606 Fax: 0086-755-33376608 Email: onv@onv.com.cn Website: www.gwsdz.com/

Zip: 518000

Headquarter Address: Room 1003, Block D, Terra Building, Futian district, Shenzhen, China

Factory Address: The 4-6th Floor, A building, SenYuTai (Science&Technologoy) Park, HuaNing Road, Dalang

sub-district, Longhua district, Shenzhen, China